

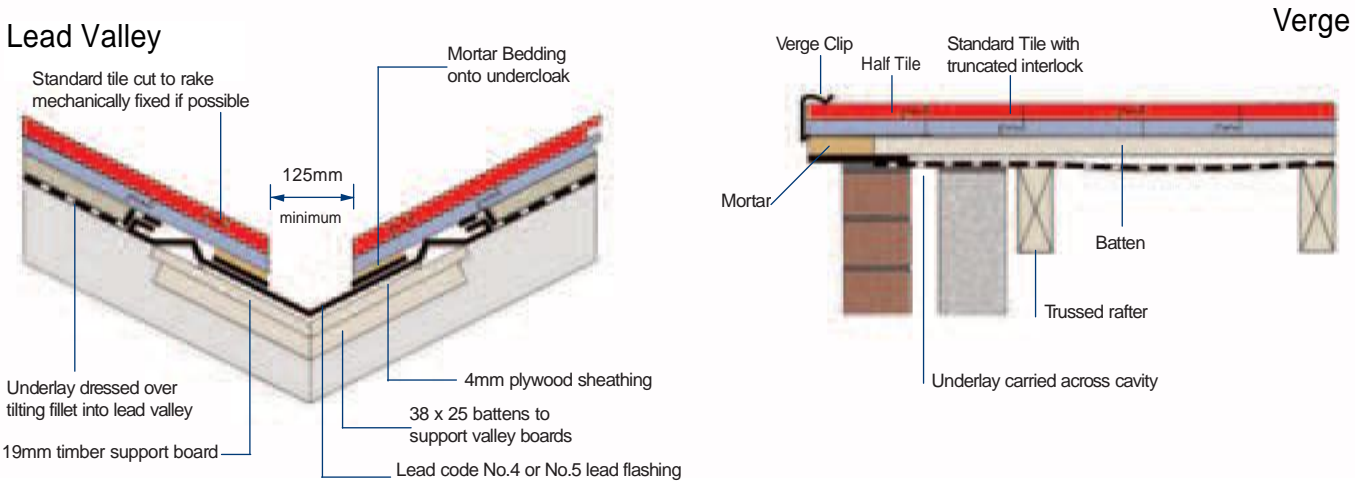


Typical Details

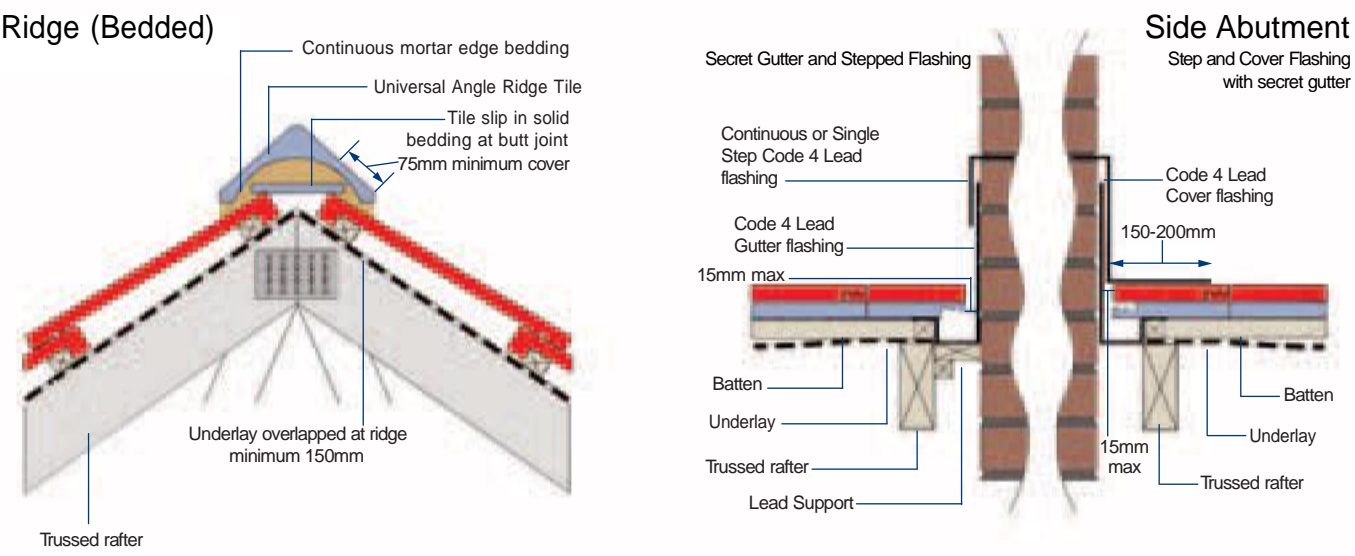

Highland Tile

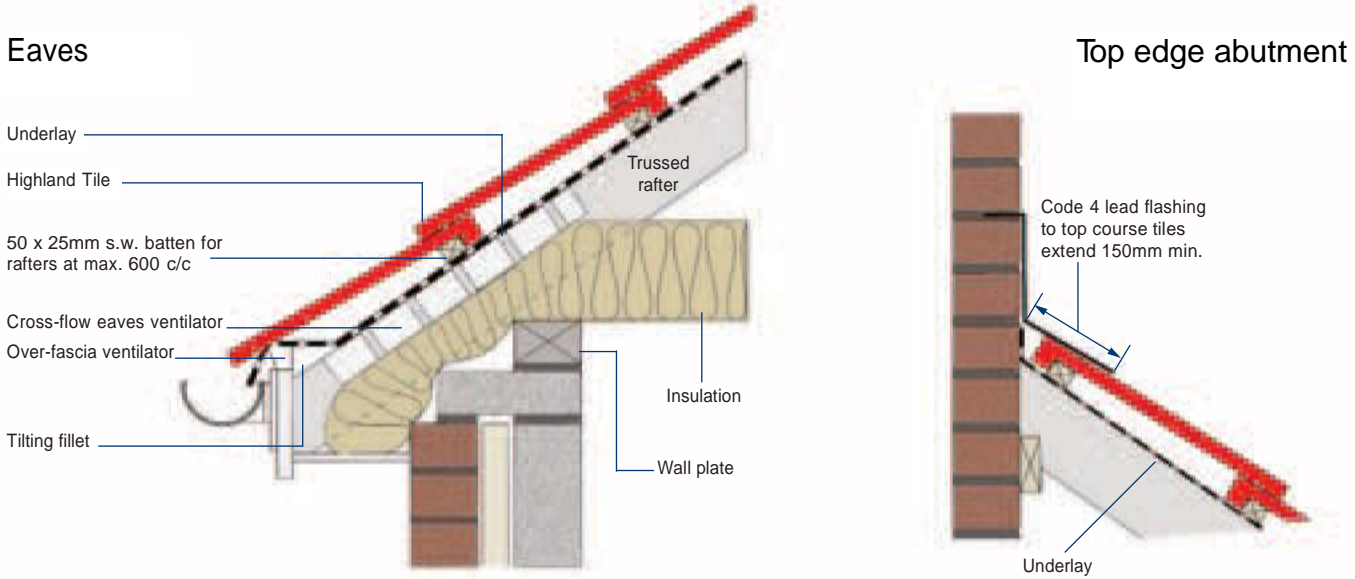

The Highland is a traditional flat roof tile with a mock joint which gives the appearance of small slates or tiles, when laid broken bond.

Features and Benefits	Tile Specification
<p>Flat interlocking single lap tile with mock joint.</p> <p>Gives appearance of smaller format tiles laid broken bonded.</p>	<p>The roof is to be covered with 418mm x 330mm Russell Highland Tiles laid broken bonded (Mock bond 1/4 bond) to a gauge of 343mm with a headlap of 75mm and fixed with 50mm x 3.35mm Aluminium alloy nails. Smooth or annular ring shank as fixing specification or clipped where necessary.</p>

Technical Data	
Compliance	Manufactured in accordance with the requirements of BS EN 490 “Concrete Roof Tiles and Fittings-Product Specifications” and BS EN 491 “Concrete Roof Tiles and Fittings-Test Methods”
Manufacture	Produced by high pressure extrusion and compaction
Fire	Non-combustible when tested to BS476: Part 3:1975 (spread of flame and fire penetration). SAA Classification
Guarantee	Tiles are guaranteed for a period of 60 years from the date of supply (subject to the normal terms of guarantee)
Maximum Pitch	60 ⁰ (Subject to fixing specification)
Minimum Pitch	17.5 ⁰ (100mm Headlap) 22.5 ⁰ (75mm Headlap) Smooth finish
Headlap (minimum)	75mm (For severe exposure contact the technical department)
Gauge (maximum)	343mm
Covering Width	298mm
Covering Capacity (net)	75mm Headlap - 9.8 Tiles/m ² 100mm Headlap - 10.6 Tiles/m ²
Weight of Tiling	75mm Headlap - 51kg/m ² (approx) 100mm Headlap - 56kg/m ² (approx)
Weight per 1000 Tiles	5.2 tonnes (approx)
Batten Size - minimum (for rafters not exceeding 600mm c/c nailed to BS5534)	50x25mm
Battens required	75mm Headlap - 2.9m per m ² 100mm Headlap - 3.1m per m ²
Ridge	Universal Angle Ridge or Multi Ridge 110 ⁰ capped Angle Ridge 90 ⁰ Angle Ridge, Feature Ridge Tiles or Finials Dry Ridge System (ventilated or unventilated) Security Ridge Gas Vent Ridge Terminal Soil/Vent Pipe Ridge Terminal
Eave	Standard Tile
Verge	Tiles laid 1/4 bond or 1/2 bond with 150mm wide fibre reinforced cement strip to provide 38-50mm overhang Russell STD interlocking Dry Verge Unit
Hips	105 ⁰ angle, 120 ⁰ angle or Universal Angle Ridge
Valleys	Open Metal Valley or GRP Valley Trough
Abutments	Abutment step and cover flashing with secret gutter or abutment flashing with secret gutter
Nails for Tiles	50mm x 3.35mm Aluminium Alloy Nail Smooth or annular ring shank dependant upon fixing specification

Tiles required along eaves	
Lin Metres	No. of Tiles
0.29	1
0.58	2
0.88	3
1.17	4
1.47	5
1.76	6
2.05	7
2.35	8
2.64	9
2.94	10
3.23	11
3.52	12
3.82	13
4.11	14
4.41	15
4.70	16
4.99	17
5.29	18
5.58	19
5.88	20
6.17	21
6.46	22
6.76	23
7.05	24
7.35	25
7.64	26
7.93	27
8.23	28
8.52	29
8.82	30
9.11	31
9.40	32
9.70	33
9.99	34
10.29	35
10.58	36
10.87	37
11.17	38
11.46	39
11.76	40
12.05	41
12.34	42
12.64	43
12.93	44
13.23	45
13.52	46
13.81	47
14.11	48
14.40	49
14.70	50
14.99	51
15.28	52
15.58	53
15.87	54
16.17	55
16.46	56
16.75	57
17.05	58
17.34	59
17.64	60
17.93	61
18.22	62
18.52	63
18.81	64
19.11	65
19.40	66
19.69	67
19.99	68
20.28	69
20.58	70
20.87	71
21.16	72
21.46	73
21.76	74
22.05	75

Rafter courses: 75mm Headlap	
Lin Metres	No. of Tiles
2.28	7
2.36	7
2.43	8
2.51	8
2.59	8
2.66	8
2.74	8
2.81	9
2.89	9
2.97	9
3.04	9
3.12	10
3.20	10
3.22	10
3.35	10
3.42	10
3.50	11
3.58	11
3.65	11
3.73	11
3.81	12
3.88	12
3.96	12
4.03	12
4.11	12
4.19	13
4.26	13
4.34	13
4.42	13
4.49	14
4.57	14
4.64	14
4.72	14
4.80	14
4.87	15
4.95	15
5.02	15
5.10	15
5.18	16
5.25	16
5.33	16
5.41	16
5.48	16
5.56	17
5.63	17
5.71	17
5.79	17
5.86	18
5.94	18
6.02	18
6.09	18
6.17	18
6.24	19
6.32	19
6.40	19
6.47	19
6.55	20
6.62	20
6.70	20
6.78	20
6.85	20
6.93	21
7.01	21
7.08	21
7.16	21
7.23	22
7.31	22
7.39	22
7.46	22
7.54	22
7.62	23

Rafter courses: 100mm Headlap	
Lin Metres	No. of Tiles
2.28	8
2.36	8
2.43	8
2.51	8
2.59	9
2.66	9
2.74	9
2.81	9
2.89	10
2.97	10
3.04	10
3.12	10
3.20	11
3.22	11
3.35	11
3.42	11
3.50	12
3.58	12
3.65	12
3.73	12
3.81	12
3.88	13
3.96	13
4.03	13
4.11	13
4.19	14
4.26	14
4.34	14
4.42	14
4.49	15
4.57	15
4.64	15
4.72	15
4.80	16
4.87	16
4.95	16
5.02	16
5.10	17
5.18	17
5.25	17
5.33	17
5.41	18
5.48	18
5.56	18
5.63	18
5.71	18
5.79	19
5.86	19
5.94	19
6.02	19
6.09	20
6.17	20
6.24	20
6.32	20
6.40	21
6.47	21
6.55	21
6.62	21
6.70	22
6.78	22
6.85	22
6.93	22
7.01	23
7.08	23
7.16	23
7.23	23
7.31	23
7.39	24
7.46	24
7.54	24
7.62	24

Fixing Note: We recommend that our customers complete a fixing specification form for the roof. The Russell service is free of charge and provides specification that complies with BS.5534. It ensures that all topographical features are accounted for and removes the potential for roof failure. For information go to: www.cemex.co.uk and click on Russell Please see additional literature for corresponding handfittings and DryFix

Recommended Specifications	
Underlay	<ul style="list-style-type: none">Roofing underlay to BS.5534 to be laid over rafters or rigid sarking, lapped horizontally and vertically to manufacturers recommendation and to be carried well into the gutters and secured with clout nailsWater traps behind fascia should be avoided by provision of a proprietary underlay support or continuous tilting fillet
Battens	<ul style="list-style-type: none">Approved quality softwood tiling battens to be laid maximum gauge 318mm secured to rafters with galvanised wire nailsTo be at least 1.2m in length and fixed at each rafter with minimum one nailTo be butt jointed over raftersNo more than one batten in four to be jointed over each rafterAll ends must be sawn
Eaves	<ul style="list-style-type: none">Standard tiles to be laid broken bond along eaves courseEnsure fascia board height or tilting fillet is correct so the eaves course is in the same plane as main roof and discharges into centre of gutter (approx. 38-50mm)All tiles to be mechanically fixed
Abutments	<ul style="list-style-type: none">Where tiling meets a top abutment tiles should be:<ul style="list-style-type: none">i. Laid as close to the wall as possibleii. Fixed with Russell Abutment Vent System and code 4 lead flashing in accordance with L.S.A. guidelines
Valleys	<ul style="list-style-type: none">To be formed with a lead lining or GRP trough fully supported by valley boardsAdjacent tiling to be cut neatly with bedded onto undercloak leaving a clear channel of not less than 150mm in accordance with L.S.A. guidelines
Mortar	<ul style="list-style-type: none">Where used it should consist of 3 parts sharp sand to 1 part Portland cement or any mix that meets BS.5534 (clause 4.15)
Hips	<ul style="list-style-type: none">To be covered with 120⁰ Angle Hip TilesEdge bed onto tiles with solid bedding at butt jointsGalvanised hip iron to be fitted at foot of each hip as support
Verges	<ul style="list-style-type: none">¼ bond can only usually be achieved by combining ¾ tiles, ½ tiles and full tiles and full tiles. Adjustments to the under cloak to up and the "shunt" in the tile width should be considered on the verge to verge roof areas.
Ridge	<ul style="list-style-type: none">To be covered with Russell Universal Angle Ridge Tiles Edge bedded onto the tiles with solid bedding at butt joints. 75mm min. cover over tops course. Provision should be made for mechanical fixing of two security ridge tiles, at each gable, party wall or abutment.Dry Ridge - Russell Ventilated and Unventilated fitted in accordance with instructions.The Russell Dry Ventilated Ridge System provides the free area equivalent of a continuous 5mm gap to meet the requirements of the Building Regulations and BS 5250